



# **INTRODUCTION**

**AKSA** POWER GENERATION

Aksa power generation system, providing optimum performance, and reliability, for stationary standby, prime power, and continuous duty applications. All generator sets are factory build, and production tested.

#### **Power (kVA)**

3 Phase, 50 Hz, PF 0.8

Voltage	STANDBY RATING (ESP)		PRIME RATING (PRP)		Standby Amper
voltage	kW	kVA	kW	kVA	
400/231	1320,00	1650,00	1200,00	1500,00	2381,64

**STANDBY RATING (ESP)** Applicable for supplying power to varying electrical load for the duration of power interruption of a reliable utility source. ESP is in accordance with ISO 8528-1. Overload is not allowed.

**PRIME RATING (PRP)** Applicable for supplying power to varying electrical load for unlimited hours. PRP is in accordance with ISO 8528-1. 10 % overload capability is available for a period of 1 hour within 12-hour period of operation.


#### **General Characteristics**

Model Name	AP 1650
Frequency (Hz)	50
Fuel Type	Diesel
Engine Made and Model	PERKINS 4012-46TAG2A
Alternator Made and Model	ECO 46-1S/4 A
Control Panel Model	DSE 7320
Canopy	AK 98

#### **ENGINE SPECIFICATIONS**

ENGINE SPECIFICATIONS	
Engine	PERKINS
Engine Model	4012-46TAG2A
Number of Cylinder (L)	12 cylinders - V type
Bore (mm.)	160
Stroke (mm.)	190
Displacement (lt.)	45.842
Aspiration	Turbo Charged
Compression Ratio	13.0:1
RPM (d/dk)	1500
Oil Capacity (Total With Filter) (It)	177
Standby Power (kW/HP)	1459/1957
Prime Power	1331/1785
Block Heater QTY	2
Block Heater Power (Watt)	3000
Fuel Type	Diesel
Injection Type and System	Direct
Type of Fuel Pump	Mechanical
Governor System	Electronic
Operating Voltage (Vdc)	24 Vdc

**AKSA** POWER GENERATION AP 1650

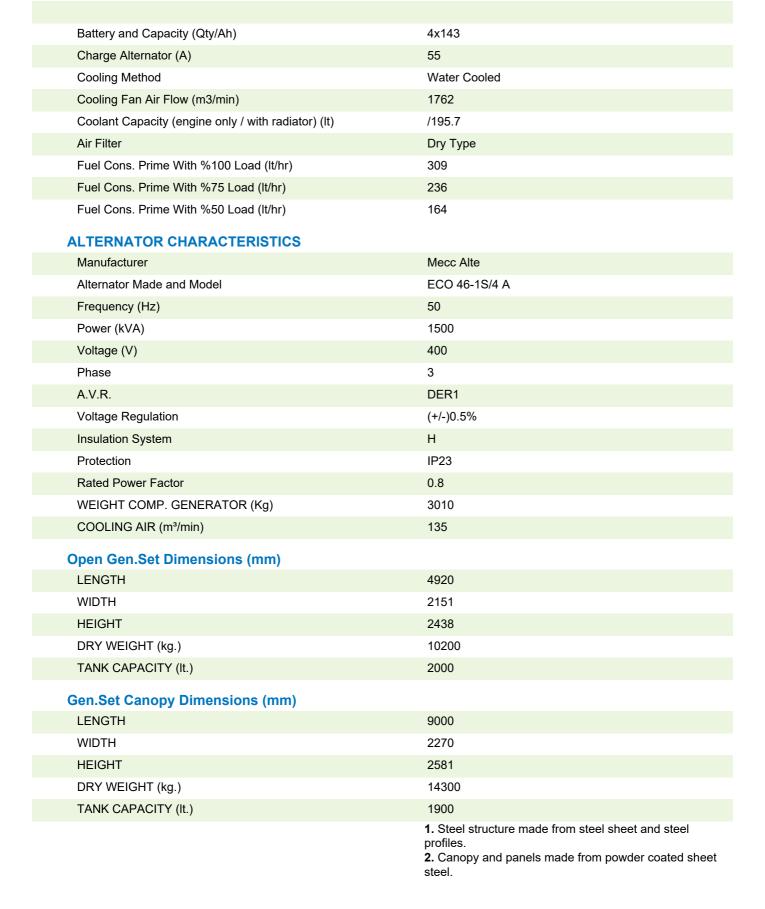





- 3. Emergency stop push button.
- 4. Control panel is mounted on the baseframe . Located
- at the back of the generator set
- 5. Cables out locations are under of the canopy.
- 6. Corrosion.resistant locks and hinges.
- 7. Oil could be drained via valve and a hose
- 8. Exhaust system on the canopy.

**9.** special large access doors (marine type) for easy maintanance

**10.** Fuel tank is at front of the canopy ,easy access to the fuel tank via lockable door.

**11.** Lifting points similar to ISO container , located on each top corner of the canopy.

**12.** The cap on the canopy provides easy accesss to radiator cap.

**13.** sound proofing materials

**14.** Integrated ladder built in to side of the canopy allows access to the top of the canopy.

## INTRODUCTION

**AKSA** POWER GENERATION

Sound-attenuated and weather protective enclosures for generating sets from Aksa, meet event the sound requirements and provide optimum protection from inclement weather and development by our specialist acoustic engineers. Our modular designed sound insulated canopies provide ease of access for servicing and general maintenance and interchangeable components permitting on-site repair. Enclosures are designed to optimize genset cooling performance, providing you with confidence that genset ratings and ambient capability.

#### **Control Panel**

Control Module	DSE	
Control Module Model	DSE 7320	
Communication Ports	MODBUS	
	<ol> <li>Menu navigation buttons</li> <li>Close mains button</li> <li>Main Status and instrumentation display</li> <li>Alarm LED's</li> <li>Close generator button</li> </ol>	

- 6. Status LED's
- 7. Operation selecting buttons

#### **Devices**

DSE, model 7320 Auto Mains Failure control module Static battery charger Emergency stop push button and fuses for control circuits

#### CONSTRUCTION and FINISH

Comonents installed in sheet steel enclosure.

Phosphate chemical, pre-coating of steel provides corrosion resistant surface

Polyester composite powder topcoat forms high gloss and extremely durable finish

Lockable hinged panel door provides for easy component access

#### **INSTALLATION**

Control panel is mounted generating set baseframe on robust steel stand or power module. Located at side of generating set with properly panel visibility.

#### **GENERATING SET CONTROL UNIT**

The DSE 7320 conrol module is a standard addition to our generator sets from 220 kVA upwards and it has been designed to start and stop diesel andgas generating sets that include electronic and non electronic engines.

The DSE 7320 includes the additional capability of being able to monitor a mains (utility) supply and is therefore suitable for controlling a standby generating set in conjunction with an automatic transfer switch.

# AP 1650



The DSE7320 also indicates operational status and fault conditions, automatically shutting down the generating set and indicating faults by means of its LCD display on the front panel.

#### STANDARD SPECIFICATIONS

Microprocessor controlled

- 132 x 64 pixel LCD display makes information easy to read
- Front panel programming and also via PC software
- Soft touch membrane keypad and five key menu navigation
- Remote communications via RS232, RS485 and ethernet.
- Event logging (50) showing date and time
- Multiple date and time engine exercise mode and maintenance scheduler
- Engine block heater control.
- Controls; stop, manuel, auto, test, start, mute lamb test/transfer to generator, transfer to mains, menu navigation.

Instruments
ENGINE
Engine speed
Oil pressure
Coolant temperature
Run time Battery volts
Engine maintenance due
GENERATOR
Voltage (L-L, L-N)
Current (L1-L2-L3)
Frequency
Earth current
kW
Pf
kVAr
kWh, kVAh, kVArh
Phase sequence
MAINS
Voltage (L-L, L-N)
Frequency
WARNING
Charge failure
Battery under voltage
Fail to stop
Low fuel level (opt.)
kW over load

**AKSA** POWER GENERATION





Negative phase sequence

Loss of speed signal

PRE-ALARMS

Low oil pressure

High engine temperature

Low engine temperature

Over /Under speed

Under/over generator frequency

Under/over generator voltage

ECU warning

SHUT DOWNS

Fail to start

Emergency stop

Low oil pressure

High engine temperature

Low coolant level

Over /Under speed

Under/over generator frequency

Under/over generator voltage

Oil pressure sensor open

Phase rotation

ELECTRICAL TRIP

Earth fault

kW over load

Generator over current

Negative phase sequence

#### Options

High oil temperature shut down

Low fuel level shut down

Low fuel level alarm

High fuel level alarm

**EXPANSION MODULES** 

Editional LED module (2548)

Expension relay module (2157)

Expansion input module (2130)

#### Standards

Elecrical Safety / EMC compatibility

BS EN 60950 Electrical business equipment

**AKSA** POWER GENERATION AP 1650



BS EN 61000-6-2 EMC immunity standard

BS EN 61000-6-4 EMC emission standard

#### **STATIC BATTERY CHARGER**

Battery charger is manufactured with switching-mode and SMD technology and it has high efficincy.

Battery charger models' output V-I characteristic is very close to square

2405 has fully output shot circuit protection and it can be used as a current source.

2405 charger has high efficiency, long life, low failure rate, light weight and low heat radiated in accordance with linear alternatives.

The charger is fitted with a protection diode across the output.

Charge fail output is available.

Connect charge fail relay coil between positive output and CF output.

Input: 196-264V.

Output: 27,6V 5A or 13,8V 5A.

### STANDARD SPECIFICATIONS

- Water cooled diesel engine
- Radiator with mechanical fan
- Protective grille for rotating and hot parts
- Electric starter and charge alternator
- Starting battery (with lead acid) including rack and cables
- Engine coolant heater
- Steel base frame and anti-vibration isolators
- Spare external fuel tank (open set)
- Flexible fuel connection hoses
- Single bearing, class H alternator
- Industrial exhaust silencer and steel bellows supplied separately
- Static battery charger
- Manual for application and installation

#### **OPTIONAL EQUIPMENTS**

#### ENGINE

Fuel-Water Seperator Filter

# Oil heater

#### ALTERNATOR

Anti-Condensation Heater

Over sized alternator

# Main line circuit breaker

# CONTROL SYSTEM

Automatic synchronising and power control system (multi gen-set Parallel)

Transition synchronization with mains

#### Remote annunciator panel

# AP 1650



Remote relay output
Alarm output relays
Remote communication with modem
Earth fault, single set
Charge Ammeter
TRANSFER SWITCH
Three or four pole contactor
Three or four pole motor operated circuit breaker
OTHER ACCESSORIES
Main Fuel Tank
Automatic or manual fuel filling system
Manual oil drain pump
Electrical oil drain pump
Low and high fuel level alarm
Residential silencer
Enclosure: weater protective or sound attenuated
Duct adapter ( on radiator)
Inlet and outlet motorised louvers
Inlet and outlet acoustic baffles
Tool kit for maintenance
1500/3000 hours maintenance kit
Supplied with oil and coolant - 30 °C
AKSA CERTIFICATES
- TS ISO 8528

- TS ISO 9001-2008

**AKSA** POWER GENERATION

- CE
- SZUTEST
- 2000/14/EC